

STANFORD STADIUM
San Jose'
9 CLEAN EXHAUST AIR SYSTEMS
In a re-circulation application



Caddy APCU equipment sits above the food court areas and below the stand seating areas.

This space is open to the concourse and the outdoors.

**After local Authority review and UL special project site review,
(with on site installation follow-up)
approval was obtained for full exhaust discharge (recirculation)
back into the concourse space.**


DISCHARGE LOCATION IS UNDER THE SEATING AREA INSIDE THE BUILDING STRUCTURE.
NOTE :THERE IS NO SMOKE OR GREASE DISCHARGED FROM THE UNIT AND THERE IS NO GREASE BUILD UP IN THE DISCHARGE DUCT WORK UNDER THE SEATING AREA.



The CAS equipment sites below the upper deck area and inside the concourse area which is open to the stadium field.



Concourse area open to the stadium field

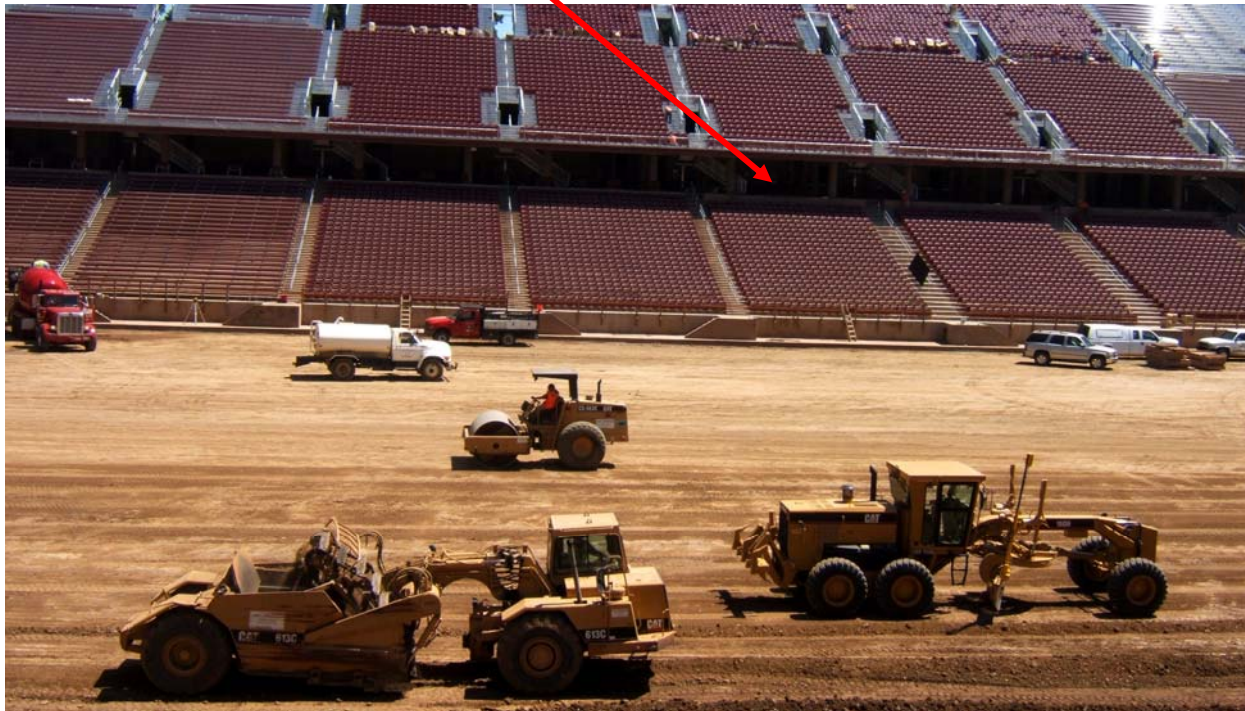

**Kiosk (Kitchen) space containing hood system
And
control panel for CAS filtration equipment above.**



Caddy CAS equipment location for 1 of 9 kiosk systems



